
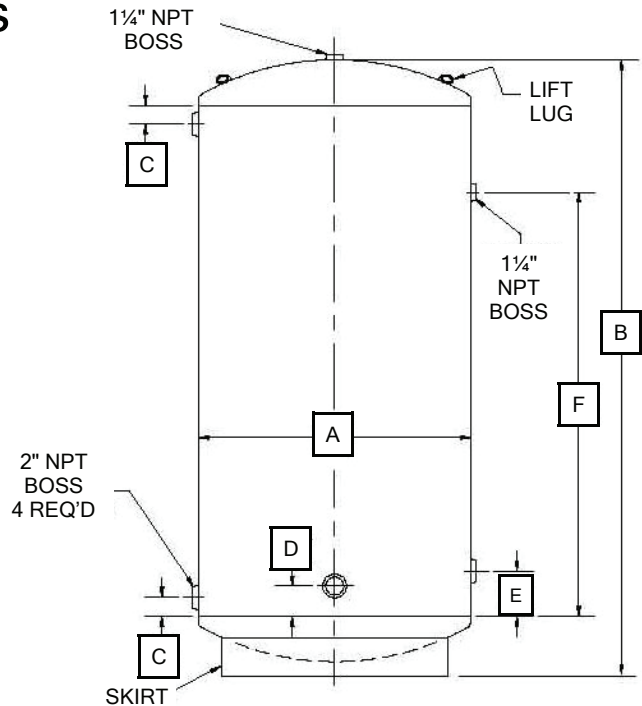


| | | |
|-------------------|---------------------------|-------------|
| Job Name: _____ | | |
| Job No: _____ | JWC Representative: _____ | |
| Tag No.: _____ | Submitted By: _____ | Date: _____ |
| Engineer: _____ | Approved By: _____ | Date: _____ |
| Contractor: _____ | Order No.: _____ | Date: _____ |

JVPG Series

Non-Code Galvanized Storage Tanks
 Certified to NSF/ANSI Standard 61
 For Potable Water Systems
 Suitable for Temperatures
 up to 73°F

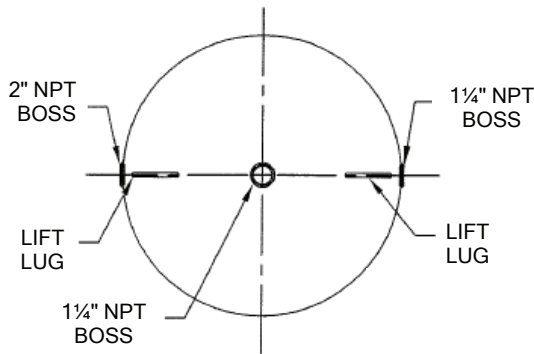

| MODEL NUMBER | MAWP | TANK VOLUME | | A DIAMETER | | B HEIGHT | | C DIM | D DIM | E DIM | F DIM | EST WEIGHT | |
|--------------|------|-------------|------|------------|-----|----------|------|-------|-------|-------|-------|------------|-----|
| | | GAL | L | IN | MM | IN | MM | | | | | LBS | KG |
| JVPG-16-314 | 75 | 525 | 1987 | 36 | 914 | 131 | 3327 | 2½ | 4 | 6 | 56 | 685 | 311 |

Dimensions are subject to change.
 Weights are approximate.